



# 中国国家强制性产品认证证书

证书编号: 2013010302628063

委托人名称、地址

北京光华世通科技有限公司  
北京市朝阳区八里庄西里1号63号楼704室

生产者(制造商)名称、地址

Santon international BV  
Hekendorpstraat 69, 3079

生产企业名称、地址

Santon international BV  
Hekendorpstraat 69, 3079

产品名称和系列、规格、型号

隔离开关

X100, 40系列; 型号解释详见附录; U<sub>i</sub>: 1000V; I<sub>th</sub>: 60A; U<sub>e</sub>: AC690V, I<sub>e</sub>: 32A, 60A; U<sub>e</sub>: DC1000V, I<sub>e</sub>: 40A; I<sub>cw</sub>: 720A/1s; I<sub>cm</sub>: 1015A; 使用类别: AC-22B, DC-21B; 直流部分产品接线方式示意图见附页

产品标准和技术要求

GB 14048.3-2008

上述产品符合强制性产品认证实施规则  
CNCA-01C-011: 2007的要求, 特发此证。

发证日期: 2013年07月11日      有效期至: 2015年12月31日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询




主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>

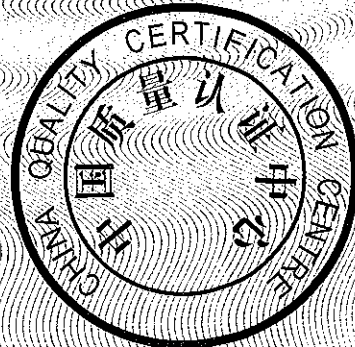

Q 0756575



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2013010302628063

## NAME AND ADDRESS OF THE APPLICANT

Beijing Green Century Technology Co., Ltd.  
Room 704 Building 63, NO.1 Balizhuang Xili Chaoyang District Beijing  
100021, PR China

## NAME AND ADDRESS OF THE MANUFACTURER

Santon international BV  
Hekendorpstraat 69, 3079

## NAME AND ADDRESS OF THE FACTORY

Santon international BV  
Hekendorpstraat 69, 3079

## NAME, MODEL AND SPECIFICATION

Isolation switch

X100.40series Ui: 1000V; Ith: 60A; Ue: AC690V, Ie: 32A, 60A; Ue: DC1000V, Ie: 40A; Icw: 720A/1s; Icm: 1015A; Utilization Category: AC-22B, DC-21B;

## THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB 14048.3-2008

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification (REF NO. CNCA-01C-011:2007).

Date of issue: Jul. 11, 2013      Date of expiry: Dec. 31, 2015

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

This certificate can be verified through CNCA's website: [www.cnca.gov.cn](http://www.cnca.gov.cn)




President: 

Wang Kejiao

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188, Nanshuan Xifu, Beijing 100070 P.R. China

<http://www.cqc.com.cn>

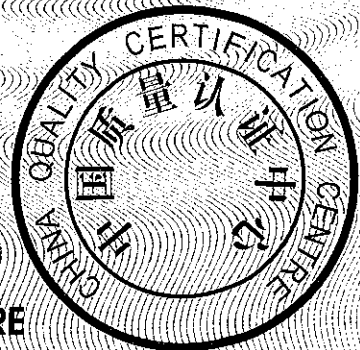

Q 0756575



# 中国国家强制性产品认证证书

附录:

第 1 页 共 3 页

证书编号: 2013010302628063


纸号: 756575

型号的解释:

X100.40DL2H-B-69.60.4-XZZZZ

Example	Description	Options
X	X type	X
100	Rated operational DC Voltage divided by ten	100
40	Rated operational DC Current	40
D	Mounting possibility, (D=Double mounting)	B Bottom mounting and DIN rail mounting D Double mounting, Bottom and Panel side P Panel mounting R Reverse panel mounting. The screws in the terminals are accessible from the bottom side.
L	Long gland panel mounting, the thickness of the panel is between 3 and 6.5mm	L, or nothing
2	The number of DC	2, 4, 6, 8
H	Positions and blockings	E, F, G, H, J, K, L, M, N, T, U, or nothing
B	Knob type	knob type between brackets
69	Rated operational AC Voltage divided by ten	69 or nothing
60	Rated operational AC nominal current	60 or 32, or nothing
4	The number of AC poles	4, or nothing

注: 此附录与证书同时使用时有效。




主任:

## 中国质量认证中心

中国·北京·南四环西路188号9区 100070

<http://www.cqc.com.cn>

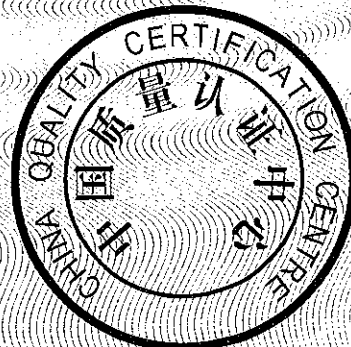





# 中国国家强制性产品认证证书

附录:


第 2 页 共 3 页

证书编号: 2013010302628063

纸号: 756575

XZZZZ	Sequential number for customer specific assemblies	Any text or number up to maximum 5 digits or nothing. (XS. is reserved for Short switches with cut off terminals in the bottom level)
-------	--	---

Switch positions and blockings  
Standard ON-OFF

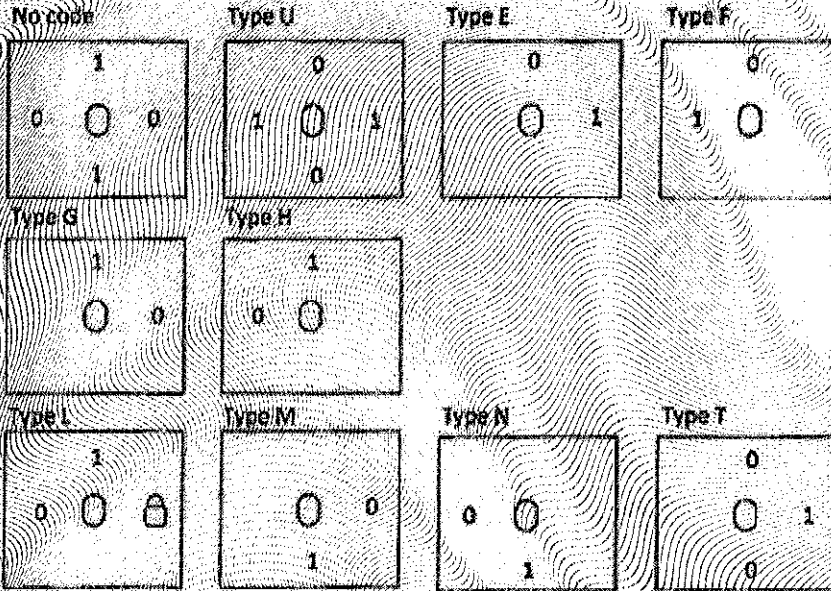

Knob types

A=standard black knob

B=pad lockable knob grey/grey

C=pad lockable knob black/grey

注: 此附录与证书同时使用时有效。




主任: 

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

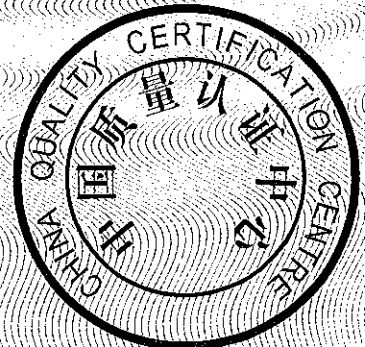



# 中国国家强制性产品认证证书

附录:

第 3 页 共 3 页

证书编号: 2013010302628063

纸号: 756575

D=standard, black, with thread through the shaft

Q=pad lockable knob, for single hole mounting

P=motor driven switch without a knob

Q=motor driven switch with black knob

R=pad lockable knob in red


S=special lockable knob in black

Shaft lengths available for the B mounting types

Length measured from the top plate

19mm, 35mm, 56mm, 67mm, any other length in custom made special

直流产品接线方式示意图:

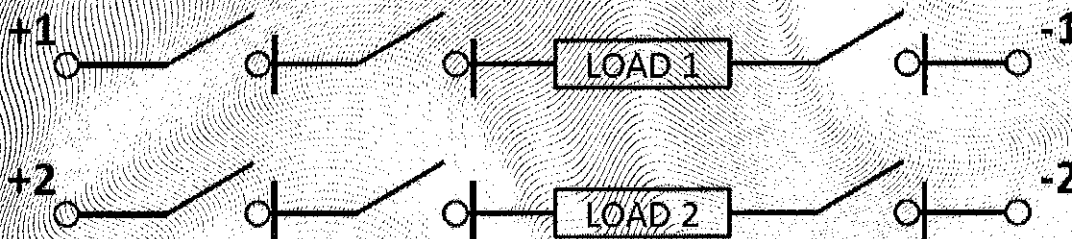

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

